



TOP VIEW

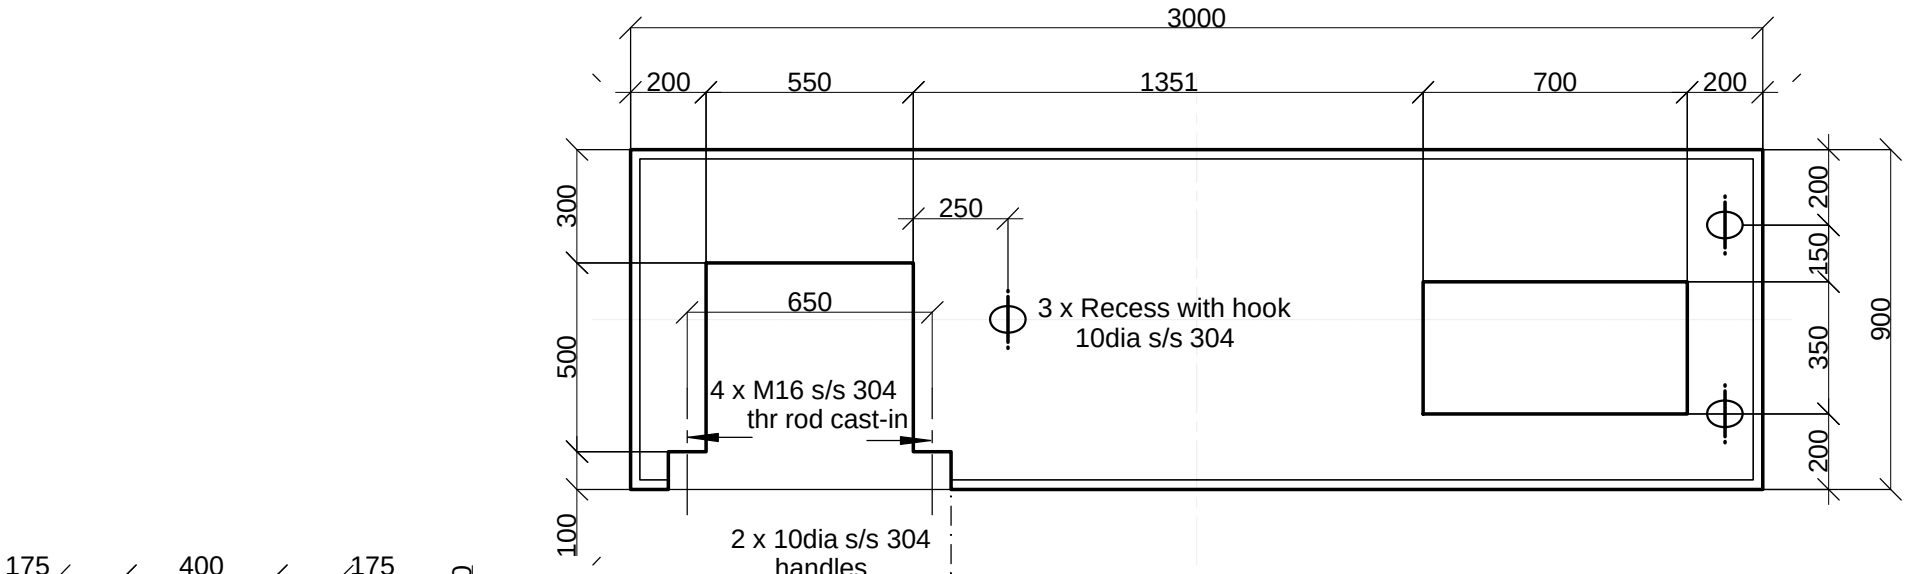

CABLE ENTRY COVER

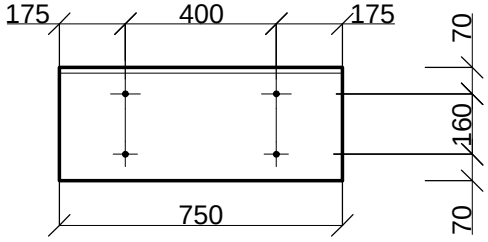

SECTION

SPECIFICATION:

1. Concrete fcu = 30MPa
2. Reinforcing steel to SANS 920
   Detailing to bending schedule.
3. All steel except reinforcing is
   stainless steel.

References:
Eskom Drawing No. D-DT-0859 Sheet 2
SAP No. 0185543
NRS 095:2012 Figure A.1
Vanstone: P8-NRS-A.1

PLINTH FOR MINI SUB-STATION
TYPE A
3000 x 900 x 300

Vanstone Precast (Pty) Ltd
www.vanstone.co.za
Tel 012 541 2056

Vanstone